

COOLING CAPACITY: 23,000 - 57,000 BTU/H
HEATING CAPACITY: 23,000 - 57,000 BTU/H

HIGH-EFFICIENCY,
COMMUNICATING,
SPLIT SYSTEM HEAT PUMP
UP TO 17 SEER & UP TO 9.7 HSPF



Contents

Nomenclature.....	2
Product Specifications.....	3
Expanded Cooling Data.....	4
Expanded Heating Data.....	20
AHRI Ratings (see note).....	22
Wiring Diagram.....	30
Dimensions.....	32
Accessories.....	32

Standard Features

- Two-Stage Copeland® UltraTech scroll compressor
- High-density foam compressor sound blanket
- Compatible with Daikin One+ smart thermostat and other Daikin communicating equipment
- Advanced Copeland CoreSense™ Technology
- Efficient ECM condenser fan motor on 5-ton model
- Simple low-voltage wiring to outdoor unit in communicating mode
- Diagnostic indicator lights and storage of six fault codes
- Color-coded terminal strip for non-communicating set-up
- High- and low-pressure switches
- Time-delay technology to ensure quiet, reliable defrost
- Factory-installed bi-flow liquid-line filter drier
- Factory-installed suction-line accumulator
- Factory-installed compressor crankcase heater
- Factory-installed high-capacity muffler
- Factory-installed coil and ambient temperature sensors
- Sweat connection service valves with easy access to gauge ports
- AHRI Certified; ETL Listed

Cabinet Features


- Grille-style sound control top design
- Custom Nickel Gray powder-paint finish
- 500-hour salt-spray tested
- Wire fan discharge grille
- Steel louver coil guard
- Single-panel access to controls with space provided for field-installed accessories
- When properly anchored, meets 2017 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)







Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov.

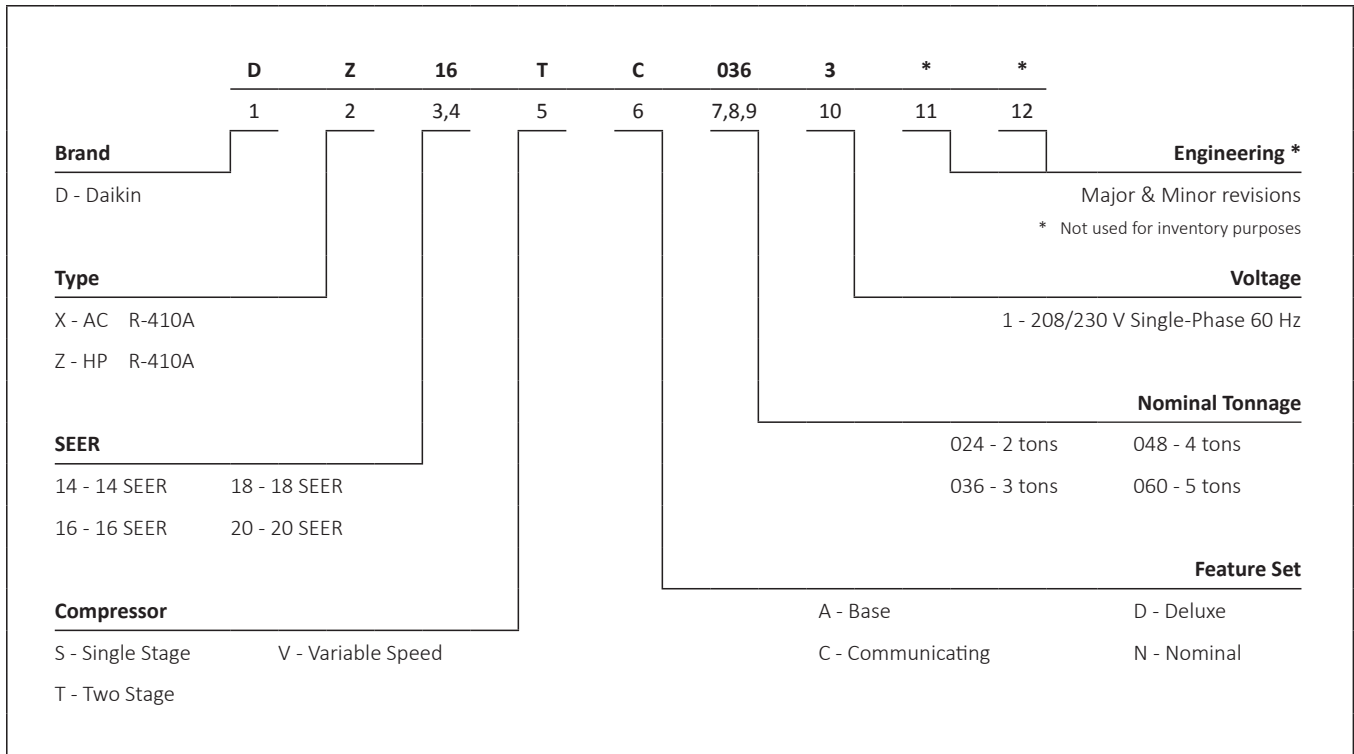

* Complete warranty details available from your local dealer or at www.daikincomfort.com. To receive the 12-Year Unit Replacement Limited Warranty and 12-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Additional requirements for annual maintenance are required for the Unit Replacement Limited Warranty. Online registration and some of the additional requirements are not required in California or Quebec.



	DZ16TC 0241C*	DZ16TC 0361C*	DZ16TC 0481C*	DZ16TC 0601C*
CAPACITIES AND RATINGS				
Nominal Cooling (BTU/h)	24,000	36,000	48,000	60,000
Nominal Heating (BTU/h)	24,000	36,000	48,000	60,000
Decibels	73	73	75	75
COMPRESSOR				
RLA	10.0	14.8	20.4	22.9
LRA	62.9	84.2	122.1	147.2
CONDENSER FAN MOTOR				
Horsepower	1/5	1/5	1/5	1/3
FLA	1.0	1.0	1.0	2.8
REFRIGERATION SYSTEM				
Refrigerant Line Size				
Liquid Line Size ("O.D.)	3/8"	3/8"	3/8"	3/8"
Suction Line Size ("O.D.)	3/4"	7/8"	1 1/8"	1 1/8"
Refrigerant Connection Size				
Liquid Valve Size ("O.D.)	3/8"	3/8"	3/8"	3/8"
Suction Valve Size ("O.D.)	3/4"	7/8"	7/8"	7/8"
Valve Connection Type	Sweat	Sweat	Sweat	Sweat
Refrigerant Charge (oz.)	176	170	244	288
ELECTRICAL DATA				
Volts -Phase (60 Hz)	208/230-1	208/230-1	208/230-1	208/230-1
Minimum Circuit Ampacity ²	13.5	19.5	26.5	31.4
Max. Overcurrent Protection ³	20	30	45	50
Min / Max Volts	197/253	197/253	197/253	197/253
Power Supply Conduit Size	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"
EQUIPMENT WEIGHT (LBS)	215	240	291	313
SHIP WEIGHT (LBS)	240	266	316	339
ENERGY STAR CERTIFIED [^]				

¹ Tested and rated in accordance with AHRI Standard 210/240

² Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

³ Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

NOTES

- Always check the rating plate for electrical data on the unit being installed.
- Installer will need to supply 7/8" to 1 1/8" adapters for suction line connections.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.
- Installation of these units requires the specified TXV Kit to be installed on the indoor coil.
THE SPECIFIED TXV IS DETERMINED BY THE OUTDOOR UNIT, NOT THE INDOOR COIL.

[^] ENERGY STAR NOTES

- Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet ENERGY STAR[®] criteria. Ask your contractor for details or visit www.energystar.gov.
- The www.energystar.gov website provides up-to-date system combinations certified to meet ENERGY STAR requirements. See Page 22 for all ENERGY STAR-certified combinations as of this document's revision date.

COOLING DATA — DZ16TC0241C* / CA*F3137*6A*+MBVC1200**-1A*+TX — HIGH STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE																							
		65°F						75°F						85°F						95°F						105°F						115°F					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
70	MBh	23.8	24.1	24.8	-	23.6	23.9	24.6	-	23.0	23.3	24.0	-	21.9	22.2	22.9	-	20.6	20.9	21.6	-	19.3	19.7	20.4	-	19.3	19.7	20.4	-	19.3	19.7	20.4	-				
	S/T	0.58	0.50	0.35	-	0.59	0.51	0.36	-	1.00	0.54	0.39	-	1.00	0.56	0.41	-	1.00	0.58	0.43	-	1.00	1.00	0.49	-	1.00	1.00	0.49	-	1.00	1.00	0.49	-				
	ΔT	20	18	15	-	20	18	15	-	20	18	15	-	20	18	15	-	20	18	15	-	21	19	16	-	21	19	16	-	21	19	16	-				
	kW	1.30	1.30	1.29	-	1.45	1.45	1.45	-	1.63	1.63	1.63	-	1.82	1.82	1.81	-	2.03	2.03	2.02	-	2.28	2.27	2.27	-	2.28	2.27	2.27	-	2.28	2.27	2.27	-				
	Amps	5.3	5.3	5.3	-	6.0	6.0	6.0	-	6.8	6.8	6.8	-	7.7	7.7	7.7	-	8.6	8.6	8.6	-	9.8	9.8	9.8	-	9.8	9.8	9.8	-	9.8	9.8	9.8	-				
Hi PR	237	238	240	-	275	276	278	-	315	316	317	-	357	358	360	-	403	404	406	-	452	453	455	-	452	453	455	-	452	453	455	-					
Lo PR	129	131	134	-	137	139	142	-	144	146	149	-	150	152	155	-	156	158	161	-	163	165	168	-	163	165	168	-	163	165	168	-					

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE																							
		65°F						75°F						85°F						95°F						105°F						115°F					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
75	MBh	23.8	24.1	24.9	26.0	23.6	24.2	24.9	26.0	23.0	23.3	24.0	25.1	21.9	22.2	22.9	24.0	20.6	20.9	21.6	22.7	19.4	19.7	20.4	21.5	19.4	19.7	20.4	21.5	19.4	19.7	20.4	21.5				
	S/T	0.81	0.73	0.58	0.42	1.00	0.73	0.59	0.43	1.00	0.68	0.53	0.37	1.00	0.70	0.55	0.39	1.00	1.00	0.66	0.50	1.00	1.00	0.63	0.47	1.00	1.00	0.63	0.47	1.00	1.00	0.63	0.47				
	ΔT	23	21	18	14	23	21	18	14	23	21	18	14	24	22	19	16	23	22	19	15	24	23	20	16	24	23	20	16	24	23	20	16				
	kW	1.31	1.31	1.30	1.31	1.46	1.46	1.46	1.47	1.64	1.64	1.63	1.64	1.83	1.82	1.81	1.82	2.03	2.03	2.02	2.04	2.27	2.27	2.27	2.28	2.27	2.27	2.27	2.28	2.27	2.27	2.28	2.28	2.29			
	Amps	5.3	5.3	5.3	5.3	6.0	6.0	6.0	6.0	6.8	6.8	6.8	6.8	7.7	7.7	7.7	7.7	8.6	8.6	8.6	8.7	9.8	9.8	9.8	9.8	9.8	9.8	9.8	9.8	9.8	9.8	9.8	9.8	9.8			
Hi PR	237	239	240	244	275	276	278	282	282	315	316	317	322	357	358	360	364	403	404	406	410	452	453	455	459	452	453	455	459	452	453	455	459				
Lo PR	129	131	134	140	137	139	142	148	148	144	146	149	155	150	152	155	161	156	158	161	166	163	165	168	174	163	165	168	174	163	165	168	174				

IDB: Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.
Shaded area reflects ACCA (TVA) conditions
Amps = outdoor unit amps (compressor + fan)
kW = Total system power

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
1080	MBh	35.5	36.0	37.0	-	35.1	35.6	36.7	-	34.2	34.7	35.8	-	32.7	33.2	34.2	-	30.7	31.2	32.3	-	29.0	29.5	30.5	-
	S/T	0.66	0.59	0.45	-	0.67	0.60	0.46	-	0.70	0.62	0.48	-	0.72	0.64	0.50	-	1.00	0.66	0.53	-	1.00	0.71	0.58	-
	ΔT	19	17	14	-	19	17	13	-	19	17	14	-	19	17	13	-	19	17	13	-	20	18	14	-
	kW	1.89	1.89	1.89	-	2.13	2.12	2.12	-	2.39	2.39	2.38	-	2.67	2.67	2.67	-	2.99	2.99	2.99	-	3.36	3.36	3.36	-
	Amps	7.6	7.6	7.6	-	8.7	8.7	8.7	-	9.9	9.9	9.9	-	11.2	11.2	11.2	-	12.6	12.6	12.6	-	14.3	14.3	14.3	-
1200	Hi PR	251	252	254	-	291	292	293	-	332	333	335	-	376	377	379	-	424	425	427	-	475	476	478	-
	Lo PR	121	123	126	-	128	130	133	-	135	136	139	-	140	142	145	-	145	147	150	-	152	153	156	-
	MBh	35.9	36.4	37.5	-	35.6	36.1	37.2	-	34.7	35.2	36.3	-	33.1	33.6	34.7	-	31.2	31.7	32.8	-	29.5	30.0	31.0	-
	S/T	0.70	0.62	0.48	-	0.70	0.63	0.49	-	0.73	0.65	0.52	-	0.75	0.67	0.54	-	1.00	0.69	0.56	-	1.00	0.74	0.61	-
	ΔT	18	16	13	-	18	16	13	-	18	16	13	-	18	16	13	-	18	16	12	-	19	17	14	-
1350	kW	1.90	1.90	1.89	-	2.14	2.13	2.13	-	2.40	2.40	2.39	-	2.68	2.68	2.68	-	3.00	3.00	2.99	-	3.37	3.37	3.37	-
	Amps	7.6	7.6	7.6	-	8.7	8.7	8.7	-	9.9	9.9	9.9	-	11.2	11.2	11.2	-	12.7	12.7	12.7	-	14.4	14.4	14.4	-
	Hi PR	253	254	256	-	292	293	295	-	334	335	336	-	378	379	381	-	426	427	429	-	477	478	480	-
	Lo PR	123	124	127	-	130	132	135	-	136	138	141	-	142	143	146	-	147	149	152	-	154	155	158	-
	MBh	36.7	37.2	38.2	-	36.4	36.9	37.9	-	35.4	35.9	37.0	-	33.9	34.4	35.4	-	32.0	32.4	33.5	-	30.2	30.7	31.7	-

1080	MBh	35.5	36.0	37.0	38.6	35.2	35.7	36.7	38.3	34.3	34.7	35.8	37.4	32.7	33.2	34.2	35.8	30.8	31.3	32.3	33.9	29.0	29.5	30.5	32.1
	S/T	0.79	0.72	0.58	0.44	0.80	0.72	0.59	0.45	1.00	0.75	0.61	0.47	1.00	0.77	0.63	0.49	1.00	0.79	0.66	0.51	1.00	0.84	0.71	0.56
	ΔT	23	21	18	14	23	21	18	14	23	21	18	14	23	21	18	14	23	21	17	14	24	22	18	15
	kW	1.89	1.89	1.88	1.90	2.13	2.12	2.12	2.14	2.39	2.39	2.38	2.40	2.67	2.67	2.67	2.68	2.99	2.99	2.98	3.00	3.36	3.36	3.36	3.37
	Amps	7.6	7.6	7.6	7.7	8.7	8.7	8.6	8.7	9.9	9.9	9.8	9.9	11.2	11.2	11.1	11.2	12.6	12.6	12.6	12.7	14.3	14.3	14.3	14.4
1200	Hi PR	251	253	254	259	291	292	294	298	332	333	335	339	376	377	379	383	424	425	427	431	475	476	478	482
	Lo PR	121	123	126	131	128	130	133	138	135	136	139	144	140	142	145	150	145	147	150	155	152	153	157	162
	MBh	36.0	36.5	37.5	39.1	35.7	36.1	37.2	38.8	34.7	35.2	36.3	37.9	33.2	33.7	34.7	36.3	31.2	31.7	32.8	34.4	29.5	30.0	31.0	32.6
	S/T	0.82	0.75	0.61	0.47	0.83	0.76	0.62	0.48	1.00	0.78	0.64	0.50	1.00	0.80	0.66	0.52	1.00	0.82	0.69	0.54	1.00	1.00	0.74	0.60
	ΔT	22	20	17	13	22	20	17	13	22	20	17	13	22	20	17	13	22	20	16	13	23	21	18	14
1350	kW	1.90	1.90	1.89	1.91	2.13	2.13	2.13	2.15	2.40	2.40	2.39	2.41	2.68	2.68	2.68	2.69	3.00	3.00	2.99	3.01	3.37	3.37	3.37	3.38
	Amps	7.6	7.6	7.6	7.7	8.7	8.7	8.7	8.8	9.9	9.9	9.9	10.0	11.2	11.2	11.2	11.3	12.7	12.7	12.6	12.7	14.4	14.4	14.3	14.4
	Hi PR	253	254	256	260	293	294	295	300	334	335	337	341	378	379	381	385	426	427	429	433	477	478	480	484
	Lo PR	123	124	127	132	130	132	135	140	136	138	141	146	142	143	146	151	147	149	152	157	154	155	158	163
	MBh	36.7	37.2	38.2	39.8	36.4	36.9	37.9	39.5	35.5	36.0	37.0	38.6	33.9	34.4	35.4	37.0	32.0	32.5	33.5	35.1	30.2	30.7	31.8	33.4

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (compressor + fan)

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE																											
		65°F						75°F						85°F						95°F						105°F						115°F									
		59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79				
700	MBh	26.5	26.9	27.7	-	-	26.3	26.6	27.4	-	-	25.6	26.0	26.7	-	-	24.4	24.8	25.6	-	-	22.9	23.3	24.1	-	-	21.6	22.0	22.8	-	-	21.6	22.0	22.8	-	-	21.6	22.0	22.8	-	-
	S/T	0.59	0.51	0.39	-	-	0.59	0.52	0.39	-	-	0.62	0.54	0.42	-	-	0.64	0.56	0.43	-	-	1.00	0.58	0.46	-	-	1.00	0.63	0.50	-	-	1.00	0.63	0.50	-	-	1.00	0.63	0.50	-	-
	ΔT	20	19	15	-	-	20	19	15	-	-	21	19	15	-	-	20	19	15	-	-	20	18	15	-	-	21	19	16	-	-	21	19	16	-	-	21	19	16	-	-
	kW	1.09	1.09	1.08	-	-	1.22	1.22	1.21	-	-	1.36	1.36	1.36	-	-	1.52	1.52	1.52	-	-	1.70	1.70	1.69	-	-	1.90	1.90	1.90	-	-	1.90	1.90	1.90	-	-	1.90	1.90	1.90	-	-
	Amps	4.5	4.5	4.5	-	-	5.1	5.1	5.1	-	-	5.8	5.8	5.8	-	-	6.5	6.5	6.5	-	-	7.3	7.3	7.3	-	-	8.3	8.3	8.3	-	-	8.3	8.3	8.3	-	-	8.3	8.3	8.3	-	-
	Hi PR	193	194	196	-	-	224	225	226	-	-	256	257	258	-	-	290	291	292	-	-	327	328	329	-	-	367	368	369	-	-	367	368	369	-	-	367	368	369	-	-
	Lo PR	123	124	127	-	-	130	132	135	-	-	137	138	141	-	-	142	144	147	-	-	148	149	152	-	-	154	156	159	-	-	154	156	159	-	-	154	156	159	-	-

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE																											
		65°F						75°F						85°F						95°F						105°F						115°F									
		59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79				
700	MBh	26.5	26.9	27.7	28.9	-	26.3	26.7	27.5	28.3	-	25.6	26.0	26.8	28.0	-	24.4	24.8	25.6	26.8	-	23.0	23.3	24.1	25.3	-	21.6	22.0	22.8	24.0	-	21.6	22.0	22.8	24.0	-	21.6	22.0	22.8	24.0	-
	S/T	0.71	0.64	0.51	0.37	-	0.72	0.64	0.51	0.38	-	1.00	0.67	0.54	0.40	-	1.00	0.69	0.56	0.42	-	1.00	0.71	0.58	0.44	-	1.00	0.75	0.62	0.49	-	1.00	0.75	0.62	0.49	-	1.00	0.75	0.62	0.49	-
	ΔT	25	23	19	16	-	25	23	19	15	-	25	23	19	16	-	25	23	19	15	-	24	22	19	15	-	26	24	20	16	-	26	24	20	16	-	26	24	20	16	-
	kW	1.09	1.09	1.08	1.09	-	1.22	1.22	1.21	1.22	-	1.36	1.36	1.36	1.37	-	1.52	1.52	1.52	1.53	-	1.70	1.70	1.69	1.70	-	1.90	1.90	1.90	1.91	-	1.90	1.90	1.90	1.91	-	1.90	1.90	1.90	1.91	-
	Amps	4.5	4.5	4.5	4.6	-	5.1	5.1	5.1	5.2	-	5.8	5.8	5.8	5.8	-	6.5	6.5	6.5	6.5	-	7.3	7.3	7.3	7.3	-	8.3	8.3	8.3	8.3	-	8.3	8.3	8.3	8.3	-	8.3	8.3	8.3	8.3	-
	Hi PR	194	194	196	199	-	224	225	226	230	-	256	257	258	261	-	290	291	292	296	-	327	328	330	333	-	367	368	369	372	-	367	368	369	372	-	367	368	369	372	-
	Lo PR	123	124	127	133	-	130	132	135	140	-	137	138	141	146	-	142	144	147	152	-	148	149	152	157	-	154	156	159	164	-	154	156	159	164	-	154	156	159	164	-

IDB: Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (compressor + fan)

DZ16TC0241C* / CA*F3137*6A*+MBVC1200**-1A*+TX – HIGH STAGE

	OUTDOOR AMBIENT TEMPERATURE																
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5
MBh	28.42	26.68	24.97	23.29	22.20	21.41	19.43	17.56	16.03	14.91	14.09	13.65	13.08	11.66	10.23	8.81	7.38
T/R	28.12	26.65	25.19	23.72	22.84	22.05	19.99	18.07	16.49	15.34	14.50	14.04	13.46	11.99	10.52	9.06	7.59
KW	1.68	1.66	1.65	1.64	1.63	1.62	1.61	1.59	1.58	1.56	1.55	1.54	1.53	1.52	1.50	1.49	1.47
AMPS	5.9	5.8	5.7	5.7	5.6	5.6	5.6	5.5	5.4	5.4	5.3	5.3	5.2	5.2	5.1	5.0	5.0
COP	4.96	4.70	4.44	4.17	4.00	3.87	3.55	3.23	2.98	2.80	2.67	2.60	2.50	2.25	1.99	1.73	1.47
Hi PR	374	362	349	337	330	325	313	301	289	277	264	257	252	240	228	216	204
LO PR	146	137	127	118	113	109	100	91	82	73	64	59	55	46	37	28	19

DZ16TC0241C* / CA*F3137*6A*+MBVC1200**-1A*+TX – LOW STAGE

	OUTDOOR AMBIENT TEMPERATURE																
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5
MBh	21.21	19.75	18.32	16.91	16.02	15.33	13.61	12.04	10.77	9.82	9.10	8.71	8.23	7.01	5.79	4.58	3.36
T/R	35.97	33.83	31.68	29.53	28.25	27.03	24.00	21.24	19.00	17.32	16.05	15.37	14.51	12.37	10.22	8.07	5.93
KW	1.03	1.01	0.98	0.96	0.94	0.93	0.90	0.88	0.85	0.83	0.80	0.79	0.78	0.75	0.72	0.70	0.67
AMPS	3.7	3.5	3.4	3.3	3.3	3.2	3.1	3.0	2.9	2.8	2.7	2.6	2.5	2.4	2.3	2.2	2.1
COP	6.02	5.75	5.48	5.19	4.99	4.83	4.41	4.02	3.70	3.48	3.33	3.25	3.11	2.74	2.34	1.92	1.46
Hi PR	362	350	339	327	320	315	303	292	280	268	256	249	244	233	221	209	197
LO PR	143	134	125	116	111	107	99	90	81	72	63	58	54	45	36	27	18

DZ16TC0361C* / CA*F3743*6D*+MBVC1600**-1A*+TX – HIGH STAGE

	OUTDOOR AMBIENT TEMPERATURE																
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5
MBh	43.10	40.55	38.05	35.59	34.00	32.84	30.01	27.28	25.04	23.40	22.23	21.60	20.77	18.71	16.64	14.57	12.51
T/R	35.53	33.76	31.99	30.21	29.15	28.21	25.73	23.39	21.47	20.07	19.06	18.52	17.81	16.04	14.27	12.49	10.72
KW	2.87	2.82	2.77	2.72	2.69	2.67	2.62	2.58	2.53	2.48	2.43	2.40	2.38	2.33	2.28	2.23	2.18
AMPS	10.8	10.6	10.3	10.1	10.0	9.9	9.7	9.5	9.3	9.1	8.8	8.7	8.6	8.4	8.2	8.0	7.8
COP	4.40	4.21	4.02	3.83	3.70	3.60	3.35	3.10	2.91	2.77	2.68	2.64	2.56	2.35	2.14	1.91	1.68
Hi PR	428	414	400	386	378	372	359	345	331	317	303	294	289	275	261	247	233
LO PR	137	128	120	111	106	103	94	86	77	69	60	55	52	43	35	26	18

DZ16TC0361C* / CA*F3743*6D*+MBVC1600**-1A*+TX – LOW STAGE

	OUTDOOR AMBIENT TEMPERATURE																
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5
MBh	32.21	30.06	27.94	25.86	24.53	23.52	21.00	18.69	16.81	15.40	14.35	13.79	13.07	11.28	9.50	7.71	5.92
T/R	38.24	36.03	33.82	31.61	30.28	29.04	25.92	23.07	20.75	19.02	17.72	17.03	16.14	13.93	11.72	9.51	7.30
KW	1.75	1.70	1.64	1.59	1.56	1.53	1.48	1.42	1.37	1.31	1.26	1.22	1.20	1.15	1.09	1.04	0.98
AMPS	6.4	6.2	6.0	5.7	5.6	5.5	5.2	5.0	4.8	4.5	4.3	4.1	4.0	3.8	3.6	3.3	3.1
COP	5.38	5.18	4.98	4.77	4.62	4.49	4.16	3.85	3.60	3.44	3.34	3.30	3.19	2.88	2.55	2.18	1.77
Hi PR	415	401	388	374	366	361	347	334	320	307	293	285	280	266	253	239	226
LO PR	134	126	117	109	104	101	92	84	76	67	59	54	51	42	34	26	17

Calculations are based on nominal CFM and 70 °F indoor dry bulb.
 Note: Shaded area is AHRI Rating Conditions at 47°F outdoor ambient temperature

Amps = Outdoor unit amps (comp.+fan)
 kW = Total system power

DZ16TC0481C* / CA*F4961*6D*+MBVC2000**-1A*+TX — HIGH STAGE

	OUTDOOR AMBIENT TEMPERATURE																
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5
MBh	60.24	56.53	52.89	49.31	47.00	45.33	41.10	37.13	33.87	31.48	29.74	28.80	27.59	24.55	21.52	18.49	15.45
T/R	33.52	31.77	30.01	28.25	27.20	26.25	23.79	21.48	19.60	18.22	17.21	16.67	15.96	14.21	12.45	10.70	8.94
KW	3.42	3.45	3.47	3.50	3.51	3.52	3.55	3.58	3.60	3.63	3.65	3.67	3.68	3.71	3.73	3.76	3.78
AMPS	12.3	12.4	12.6	12.7	12.7	12.8	12.9	13.0	13.1	13.2	13.3	13.4	13.5	13.6	13.7	13.8	13.9
COP	5.16	4.81	4.46	4.13	3.92	3.77	3.39	3.04	2.76	2.54	2.38	2.30	2.20	1.94	1.69	1.44	1.20
Hi PR	405	392	379	366	358	352	339	326	313	300	286	279	273	260	247	234	221
LO PR	131	123	115	107	102	99	91	82	74	66	58	53	50	41	33	25	17

DZ16TC0481C* / CA*F4961*6D*+MBVC2000**-1A*+TX — LOW STAGE

	OUTDOOR AMBIENT TEMPERATURE																
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5
MBh	44.95	41.85	38.81	35.81	33.91	32.44	28.78	25.46	22.76	20.74	19.21	18.39	17.35	14.77	12.18	9.59	7.01
T/R	40.84	38.39	35.95	33.50	32.04	30.65	27.19	24.06	21.51	19.59	18.15	17.37	16.39	13.95	11.51	9.06	6.62
KW	2.12	2.10	2.07	2.05	2.03	2.02	1.99	1.97	1.94	1.92	1.89	1.87	1.86	1.84	1.81	1.79	1.76
AMPS	7.7	7.6	7.5	7.3	7.3	7.2	7.1	7.0	6.9	6.8	6.7	6.6	6.5	6.4	6.3	6.2	6.1
COP	6.20	5.85	5.49	5.13	4.89	4.71	4.23	3.79	3.44	3.17	2.98	2.88	2.73	2.35	1.97	1.57	1.17
Hi PR	393	380	367	354	347	341	329	316	303	290	278	270	265	252	239	227	214
LO PR	129	121	113	105	100	97	89	81	73	65	57	52	49	41	33	25	17

DZ16TC0601C* / CA*F4961*6D*+MBVC2000**-1A*+TX — LOW STAGE

	OUTDOOR AMBIENT TEMPERATURE																
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5
MBh	77.42	72.40	67.46	62.61	59.50	57.20	51.36	45.97	41.58	38.31	35.90	34.60	32.94	28.79	24.64	20.49	16.34
T/R	40.55	38.29	36.03	33.77	32.41	31.15	27.97	25.04	22.65	20.87	19.55	18.85	17.94	15.68	13.42	11.16	8.90
KW	4.70	4.67	4.64	4.61	4.59	4.58	4.55	4.52	4.49	4.46	4.43	4.41	4.40	4.37	4.34	4.31	4.28
AMPS	17.7	17.6	17.5	17.3	17.3	17.2	17.1	16.9	16.8	16.7	16.5	16.5	16.4	16.3	16.2	16.0	15.9
COP	4.83	4.55	4.26	3.98	3.80	3.66	3.31	2.98	2.72	2.52	2.38	2.30	2.20	1.93	1.67	1.39	1.12
Hi PR	460	445	430	415	406	400	385	370	355	340	325	316	310	295	280	265	250
LO PR	134	126	117	109	104	101	92	84	76	67	59	54	51	42	34	26	17

DZ16TC0601C* / CA*F4961*6D*+MBVC2000**-1A*+TX — HIGH STAGE

	OUTDOOR AMBIENT TEMPERATURE																
	65	60	55	50	47	45	40	35	30	25	20	17	15	10	5	0	-5
MBh	57.01	53.11	49.45	45.46	42.92	40.93	36.01	31.58	27.98	25.27	23.20	22.09	20.70	17.23	13.76	10.28	6.81
T/R	46.24	43.34	40.44	37.55	35.81	34.14	30.03	26.34	23.34	21.08	19.35	18.43	17.27	14.37	11.47	8.58	5.68
KW	2.89	2.82	2.76	2.69	2.65	2.62	2.56	2.49	2.42	2.36	2.29	2.25	2.23	2.16	2.09	2.03	1.96
AMPS	10.8	10.5	10.2	9.9	9.8	9.6	9.4	9.1	8.8	8.5	8.2	8.0	7.9	7.6	7.3	7.0	6.8
COP	5.78	5.51	5.26	4.95	4.75	4.57	4.13	3.71	3.38	3.14	2.97	2.88	2.73	2.34	1.93	1.49	1.02
Hi PR	445	431	416	402	393	387	373	358	344	329	315	306	300	286	272	257	243
LO PR	132	123	115	107	102	99	91	83	74	66	58	53	50	42	33	25	17


Calculations are based on nominal CFM and 70 °F indoor dry bulb.

Note: Shaded area is AHRI Rating Conditions at 47°F outdoor ambient temperature

Amps = Outdoor unit amps (comp.+fan)


kW = Total system power

***ALL AHRI SYSTEM RATINGS ARE ACCESSIBLE IN THE UNITARY MATCHUP TOOL VIA
DAIKIN CITY OR IN THE DAIKIN SYSTEM CONFIGURATOR TOOL VIA PARTNERLINK.***

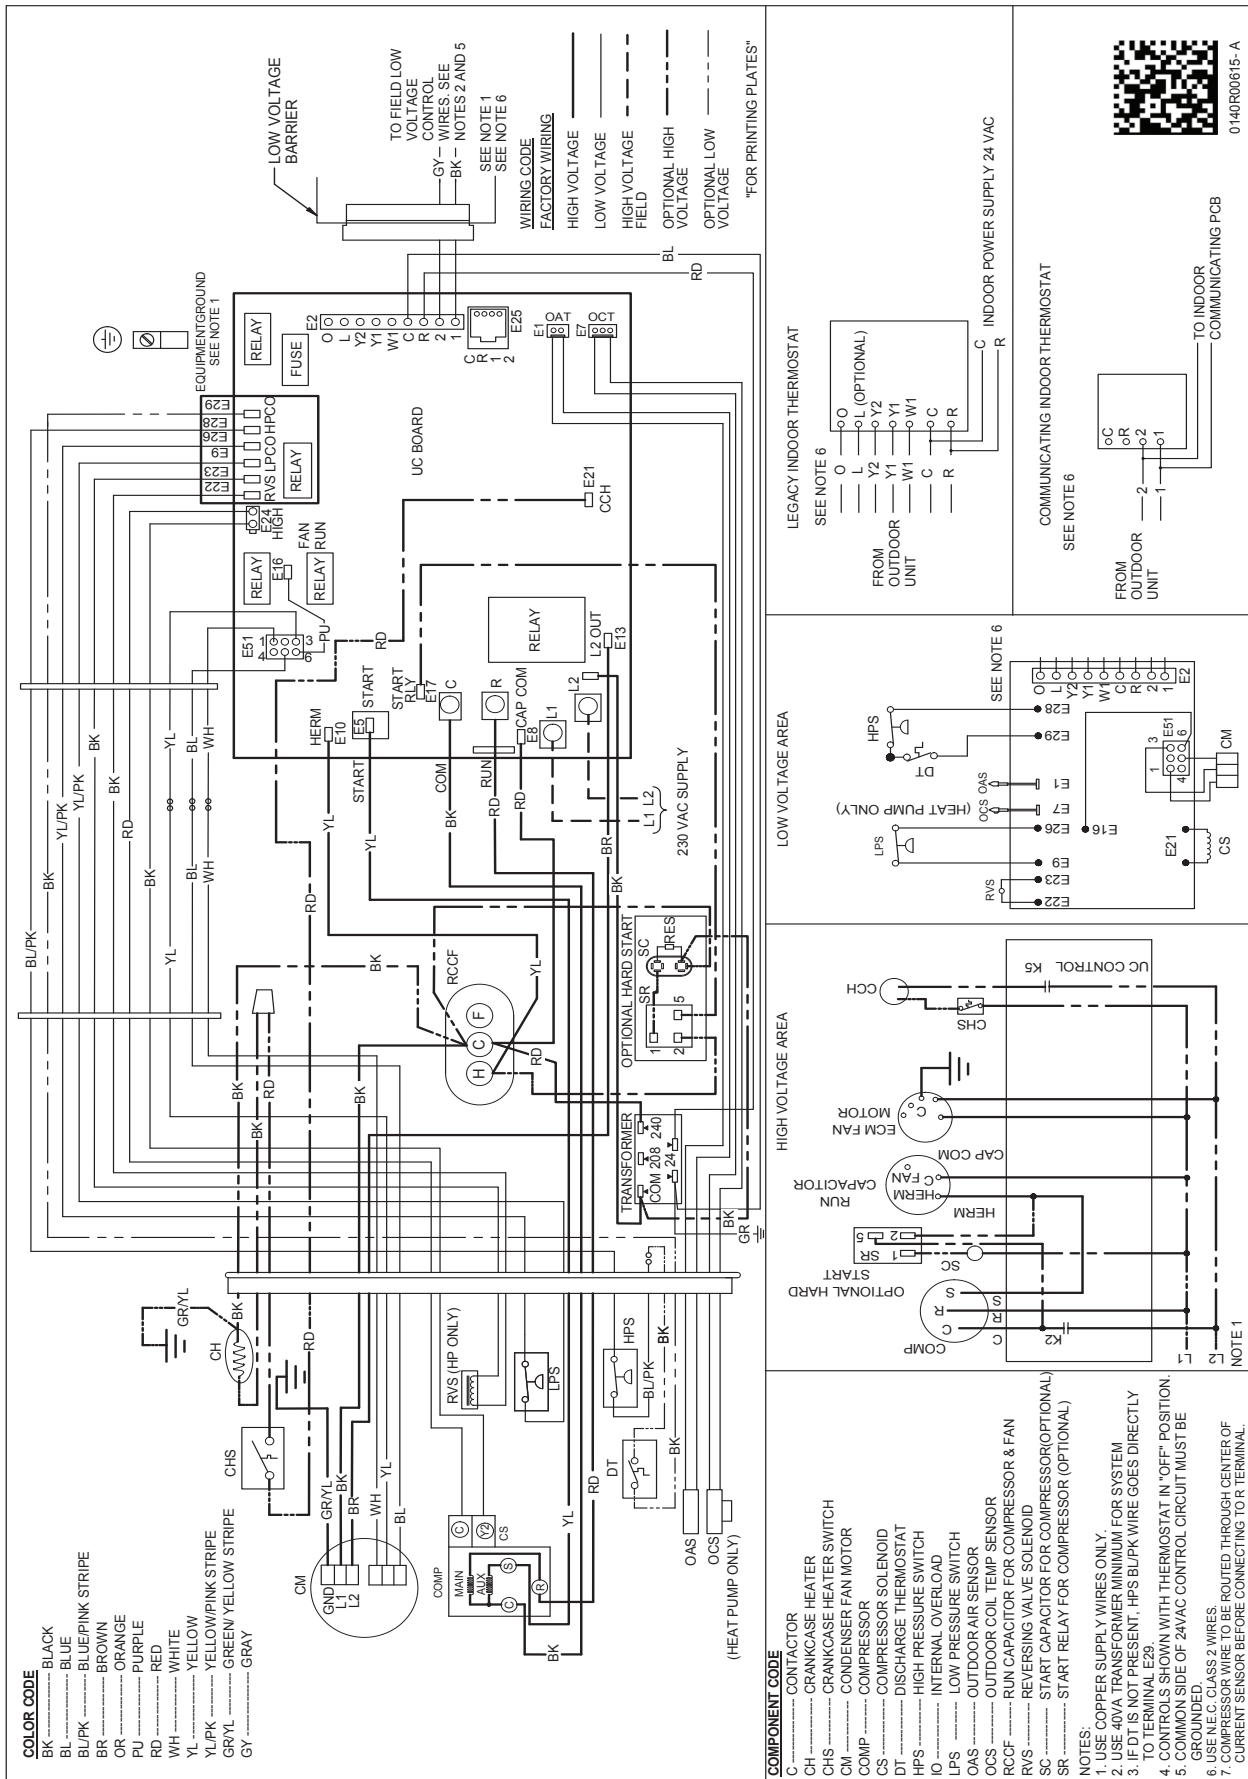

WARNING
 High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

Wiring is subject to change. Always refer to the wiring diagram on the unit for the most up-to-date wiring.

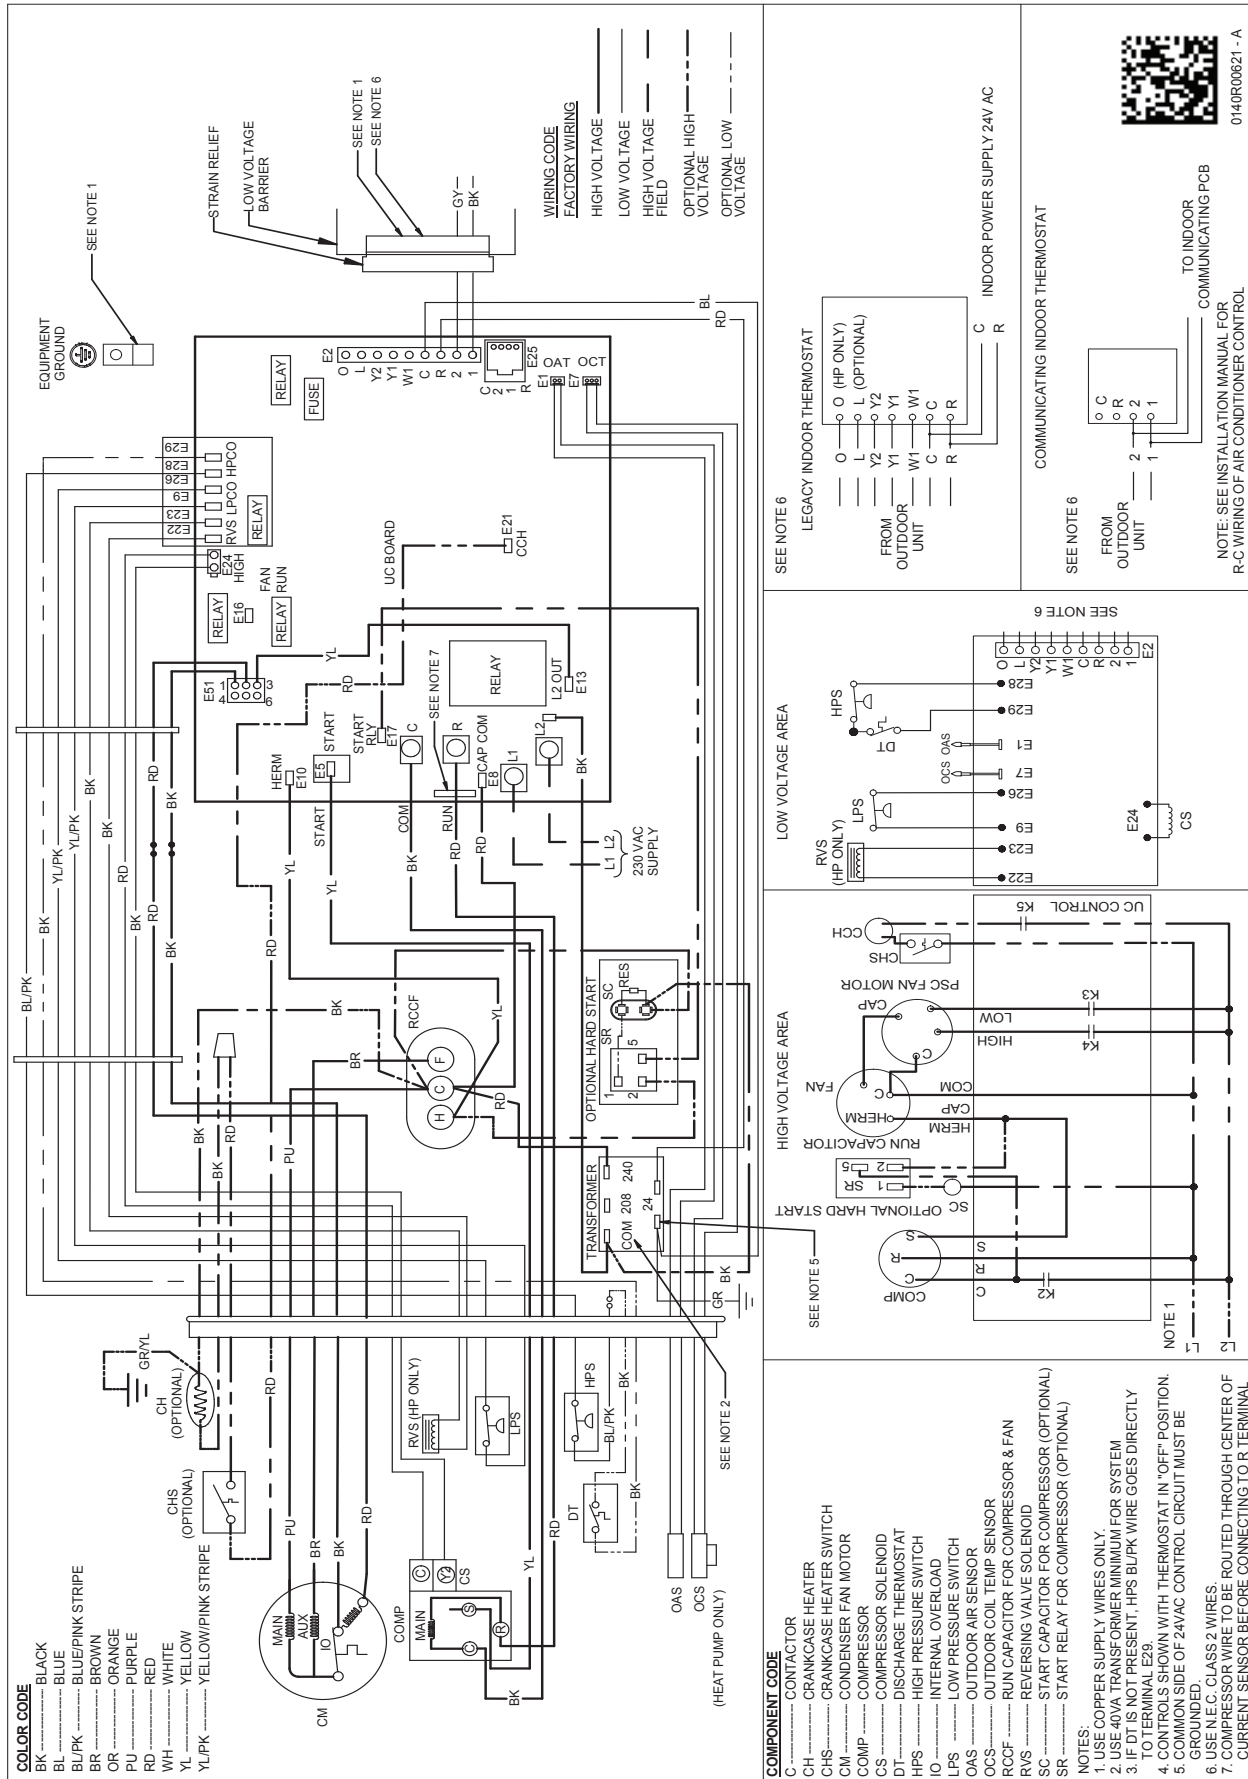


WARNING

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

8	7	6	5	4	3	2	1					
						ECN XXXXXXXX	REV A	ZONE XXXXX	DESCRIPTION	EHK -	D GL	DATE

MODEL	DIMENSIONS		
	W"	D"	H"
DZ16TC0241C*	35½	35½	34¾
DZ16TC0361C*	35½	35½	40
DZ16TC0481C*	35½	35½	34¾
DZ16TC0601C*	35½	35½	40

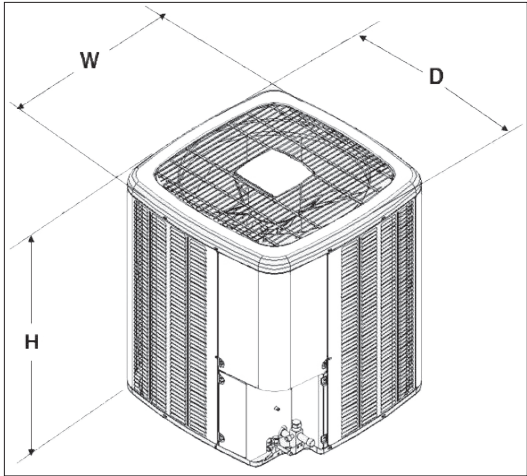

Daikin Manufacturing Company, LLC		
DRAWING TO BE REFERENCED BY ACCORDANCE WITH ASME Y14.200 DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED		
DZ16TC Heat Pump		
TOLERANCES: ANGLES ± 1° X ± 1 / 32 ± 0.01 XXX ± 0.015 HOLE Ø ± 0.005 TUBE CUT L/S ± 0.002	DRAWN BY: _____	ENG: _____
SPECIAL CHARACTERISTICS: ⊕ = SIGMA ⊕ = CRITICAL CHARACTERISTIC ⊕ = SIGNIFICANT CHARACTERISTIC	COMPONENTS AND MATERIALS SPECIFIED HEREIN WILL ALSO CONFORM TO THE APPLICABLE SECTION OF GOODMAN MSP #24.01 WORKMANSHIP STANDARD FOR FIT, FEEL AND FINISH. CONFIDENTIAL PROPERTY OF THE GOODMAN MANUFACTURING COMPANY, L.P. NOT TO BE DISCLOSED TO OTHER, COPIED, OR USED FOR ANY PURPOSE EXCEPT AS AUTHORIZED IN WRITING. MUST BE RETURNED UPON DEMAND, ON COMPLETION OF ORDER, OR OTHER PURPOSE FOR WHICH IT WAS LENT.	
8	7	6

ACCESSORIES

MODEL	DESCRIPTION	DZ16TC 0241C*	DZ16TC 0361C*	DZ16TC 0481C*	DZ16TC 0601C*
ABK-20	Anchor Bracket Kit ⁰	X	X	X	X
B1141643	24V Transformer ¹	X	X	X	X
CSR-U-1	Hard-start Kit	X	X		
CSR-U-2	Hard-start Kit		X	X	X
CSR-U-3	Hard-start Kit			X	X
FSK01A	Freeze Protection Kit ²	X	X	X	X
OT18-60A	Outdoor Thermostat/Lockout Thermostat ³	X	X	X	X
TX2N4A	TXV Kit ⁴	X			
TX3N4	TXV Kit ⁴		X		
TX5N4	TXV Kit ⁴			X	X

- ⁰ Contains 20 brackets; four brackets needed to anchor unit to pad
- ¹ Available in 24V legacy mode only. This feature is integrated in the communicating mode.
- ² Installed on indoor coil
- ³ Available in 24V legacy mode only. This feature is integrated in the communicating mode. Required for heat pump applications where ambient temperature falls below 0°F with 50% or higher relative humidity.
- ⁴ Condensing units and heat pumps with reciprocating compressors require the use of start-assist components when used in conjunction with an indoor coil using a non-bleed thermal expansion valve refrigerant metering device or liquid line solenoid kit. The TXV should always be sized based on the tonnage of the outdoor unit.

